


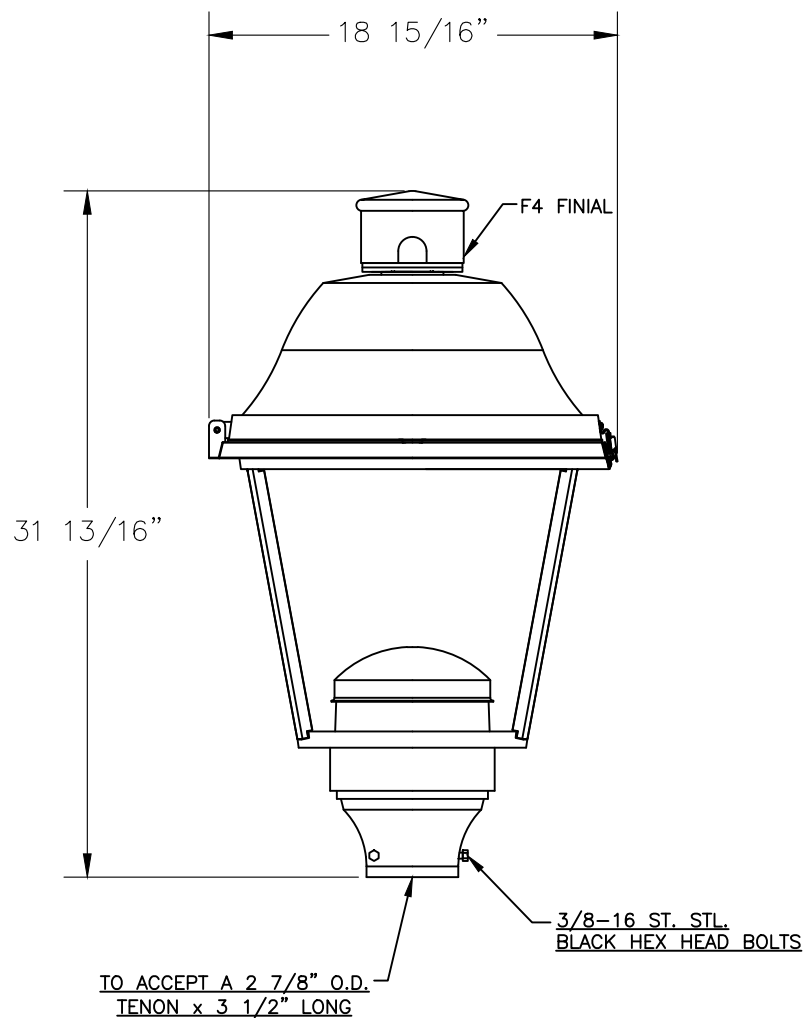

NOTE:

ALL THUMB SCREWS WOULD BE REPLACED BY HEX HEAD BOLTS
 **ANTI SIEZE COMPOUND MUST BE APPLIED TO ALL THREADED BOLTS
 PRIOR TO INSTALLATION AT FACTORY**

REV.	ALTERATION	DATE	BY
B	WATTAGE SELECTOR ADDED	03/21/24	J.H.

LUMINAIRE SPECIFICATIONS

CATALOGUE NO.: K611-T-P4NL-III-75(SSL)-7030
 -120:277-F4-PR7-3K-WS

QUANTITY:
 OPTICAL SYSTEM: FLAT ARRAY NO LENS
 IES CLASS.: TYPE III
 WATTAGE: 75W (7030 SERIES)
 SOLID STATE LIGHTING
 INPUT VOLTAGE: 120:277V
 CCT: 3000K
 POLE ADAPTOR: T-STYLE
 PAINT: TEXTURED BLACK
 OPTIONS: F4 FINIAL,
 TWISTLOCK RECEPTACLE
 (PHOTO-EYE BY OTHERS)
 WATTAGE SELECTOR

OPTIONS

QUICK DISCONNECT ☒

CUSTOMER APPROVAL & DATE:

  King Luminaire • StressCrete • Est. 1953 STRESSCRETE GROUP		<u>Manufacturing Locations:</u> Burlington, Ontario 1-800-268-7809 Northport, Alabama 1-800-435-6563 Atchison, Kansas 1-800-837-1024 Jefferson, Ohio 1-800-268-7809	
PROJECT/CUSTOMER:			
LCEC K611			
DRAWN BY:	AT:	CHECKED BY:	DATE:
SA	SC2		04/06/23
KING U.S. ORDER No:		DRAWING TYPE:	
-		CONCEPT DWG.	
		DRAWING NUMBER:	
		Q-2303076-1	